

COMPLEX INVESTIGATIONS AND ASSESSMENTS OF TECHNICAL STATE OF STEEL PENSTOCKS AND THEIR STRENGTH AND LIFETIME

Key words: hydropower plant, steel penstock, stress distribution, FEM, strain gauge measurements, non-destructive tests, waterhammer, model of microcracks growth, penstock residual time, reinforcement

Tests and analyses performed for complex assessment of technical state of a steel penstock together with determining its strength and lifetime have the main goal in determining possibilities to extent penstock safety life.

Offered non-destructive tests include mainly visual tests, ultrasonic measurements, magnetic and radiography examination of penstock shells.

Numerical analysis of stress distributions in steel penstock shells is based on the Finite Element Method (FEM) with internal or external pressure levels as boundary conditions. Strain gauge measurements can be executed in selected spots on penstock shell under hydrostatic and hydrodynamic loads during different steady and unsteady states of hydrounit operation. The results of strain gauge measurements are principally used to verify and to estimate a reliability of stress state calculation results concerning spots on a penstock shell characterized by large geometrical imperfections.

Analysis and evaluations of the penstock lifetime (residual time) are mainly based on the theory of microcracks growth connected with rainflow models for counting of stress cycles. Necessary knowledge about pressure-time changes during all different states of hydrounit operation is gathered from tests conducted *in situ* or calculated using software for waterhammer simulation. In addition, the knowledge about static and variable loads of the pipeline during its past and future operation courses is needed to perform all the analyses and assessments.

Occasionally, basing on the test results some recommendations are made to reinforce the places characterized by the highest material strains, such as pipe branches or geometric imperfections of the pipe shell (concave or convex shell bends).

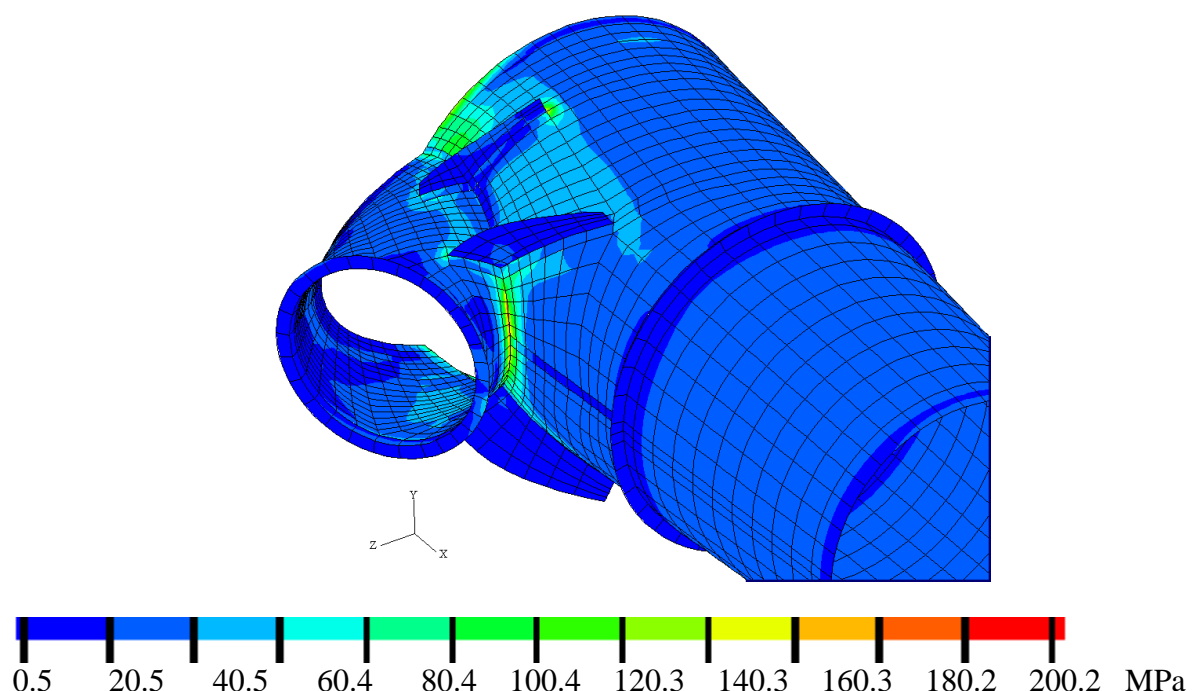


Fig. 1 Case without additional reinforcement. Reduced stresses (according to Huber-Misses hypothesis) in shell of turbine penstock branching – outer side.

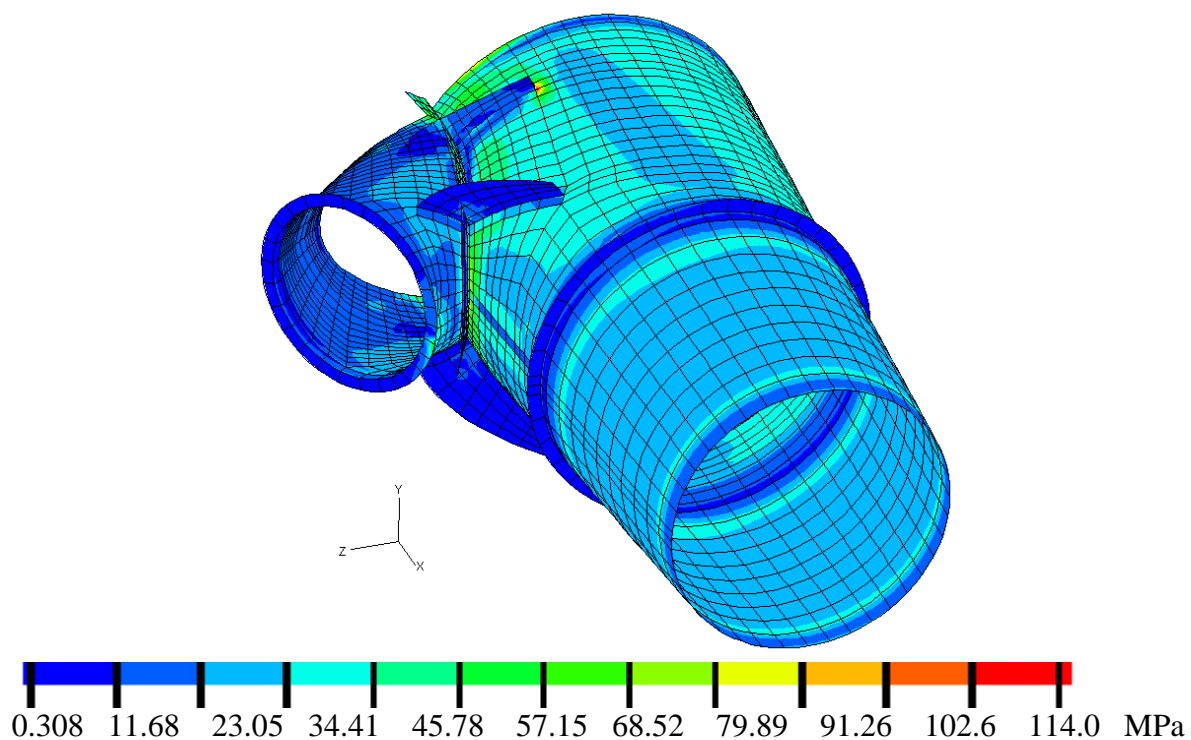


Fig. 2 Reduced stresses (according to Huber-Mises hypothesis) in shell of turbine branching reinforced with a fin.



Fig. 3 Strengthening fin at pipeline branching

References:

Adamkowski, A., Lewandowski, M., Lewandowski, S.: *Evaluation of the remaining lifetime of steel penstocks in hydropower plants*, Proceedings of 16th International Seminar on Hydropower Plants, Vienna 2010, pp. 29-42 – [pdf version](#).

Adamkowski, A.: *Problems of assessing technical state, strength and lifetime of hydraulic turbine flow system components* – [pdf version](#)

Adamkowski, A., Kwapisz, L.: *Strength analysis of penstock bifurcations in hydropower plants*, Proceedings of 12. International Seminar “WASSERKRAFTANLAGEN – Sicherheit und/oder Risiko” TU Wien, 27-29 November 2002, pp. 125-156. – [pdf version](#)

Adamkowski, A.: *Case Study: Lapino Powerplant Penstock Failure*, ASCE Jour. of Hydraulic Engineering, July 2001, Vol.127, No.7, pp. 547-555. – [pdf version](#)

For more details please contact:

Adam Adamkowski, DSc., Ph.D.

The Szwedzki Institute of Fluid-Flow Machinery, PASci (IMP PAN)
Centre for Mechanics of Liquids, Department of Hydraulic Machinery
ul. Fiszera 14;
80-952 Gdańsk, Poland
Phone: +48 58 69 95 212
Fax: +48 58 341 61 44
Mobile: +48 606 571 642
E-mail: aadam@imp.gda.pl